



The testing data you are about to view is provided for informational purposes only. No warranty is expressed or implied regarding the characteristics of these products. The gradation of the products and their physical / mineralogical properties may vary over time. The test results represent measured properties from typical samples, and should not be used for engineering design. Samples of the materials are available upon request for additional independent confirmation.

The percent moisture data viewed below pertains specifically to the Standard Proctor test for purposes of characterizing moisture-density relationships, and does not represent water contents of products purchased from the mine.

PROCTOR SUMMARY LOG			SUMMARY OF TEST RESULTS	
	Moisture (%)	Dry Density (pcf)	Standard Proctor Test ASTM D698	
Point 1	11.8	103.1	Method A	
Point 2	12.6	104.5	Maximum Dry Density (pcf):	105.6
Point 3	14.3	105.6	Optimum Moisture Content (%):	14.3
Point 4	16.9	104.3	Lab ID Number:	4

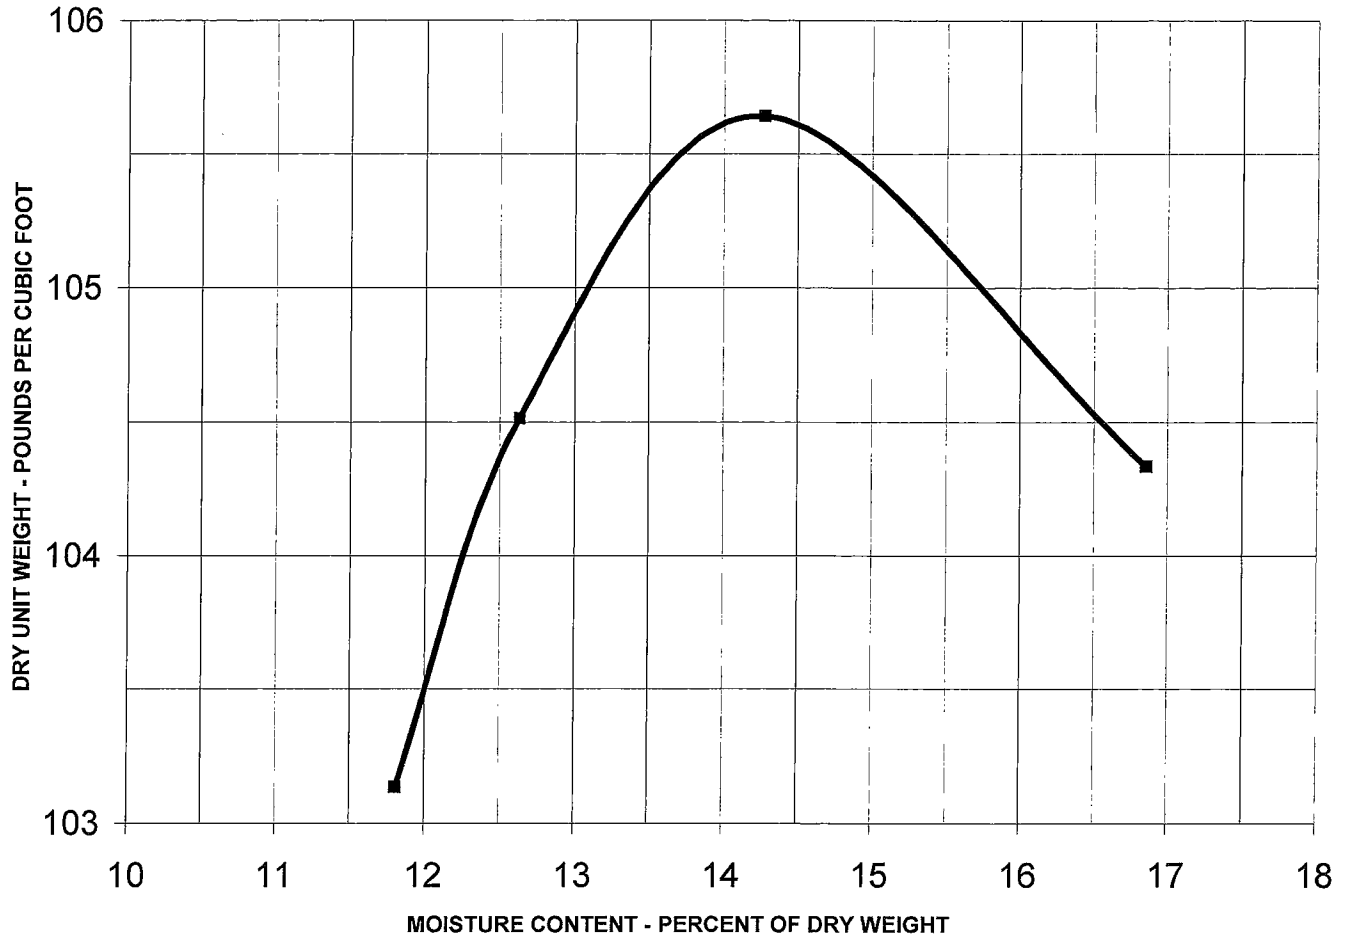

Sample Location.	Green Bay	<b>MOISTURE - DENSITY RELATIONSHIP</b>	
		Sand Mine Product Testing	
Sample Description.	Concrete Sand	E.R Jahna	
USCS Classification:	SP	Project No: LKL-08-0003	
Retained on No.4 Sieve (%):	0.0	Tested By: AG	
Passing No. 200 Sieve (%):	0.2	Checked By: TS	
<b>DUNKELBERGER</b> engineering & testing, inc.		 Jeffery A. Beriswill Director, Dams & Water Resources License Number No. 41823	