

ARDAMAN & ASSOCIATES, INC. GEOTECHNICAL TESTING LABORATORY PROCTOR COMPACTION TEST REPORT


CLIENT : E.R. Jahna Industries, Inc.
 PROJECT: Laboratory Testing
 FILE NO.: 14-13-0089

INCOMING SAMPLE NO.: S-1
 BORING: - SAMPLE: -
 DEPTH: - ft. m
 LABORATORY IDENTIFICATION NO.: 140089/S1
 SAMPLE DESCRIPTION: Very light brown sand, SP

DATE SAMPLE RECEIVED: 08/11/14
 DATE TEST SET-UP: 08/12/14
 DATE REPORTED: 08/15/14

TEST METHOD AND SPECIMEN PREPARATION

Test Type: <input type="checkbox"/> Standard Effort ASTM D698 <input checked="" type="checkbox"/> Modified Effort ASTM D1557 Test Method: <input checked="" type="checkbox"/> A <input type="checkbox"/> B <input type="checkbox"/> C Preparation Method: <input type="checkbox"/> Moist <input checked="" type="checkbox"/> Dry Rammer Type: <input type="checkbox"/> Manual <input checked="" type="checkbox"/> Mechanical Soil Reused: <input checked="" type="checkbox"/> No <input type="checkbox"/> Yes <u>-</u> Times	Particle-Size: <input checked="" type="checkbox"/> Estimated <input type="checkbox"/> Measured - % + 3/4"; - % + 3/8"; - % + No. 4 Test Fraction (%): <u>100</u> Oversized Fraction (%): <u>0</u> As-Received Water Content (ASTM D2216): <u>-</u> % OPTIMUM WATER CONTENT (%): <u>10.0</u> MAXIMUM DRY DENSITY (lb/ft ³): <u>109.6</u>
--	---

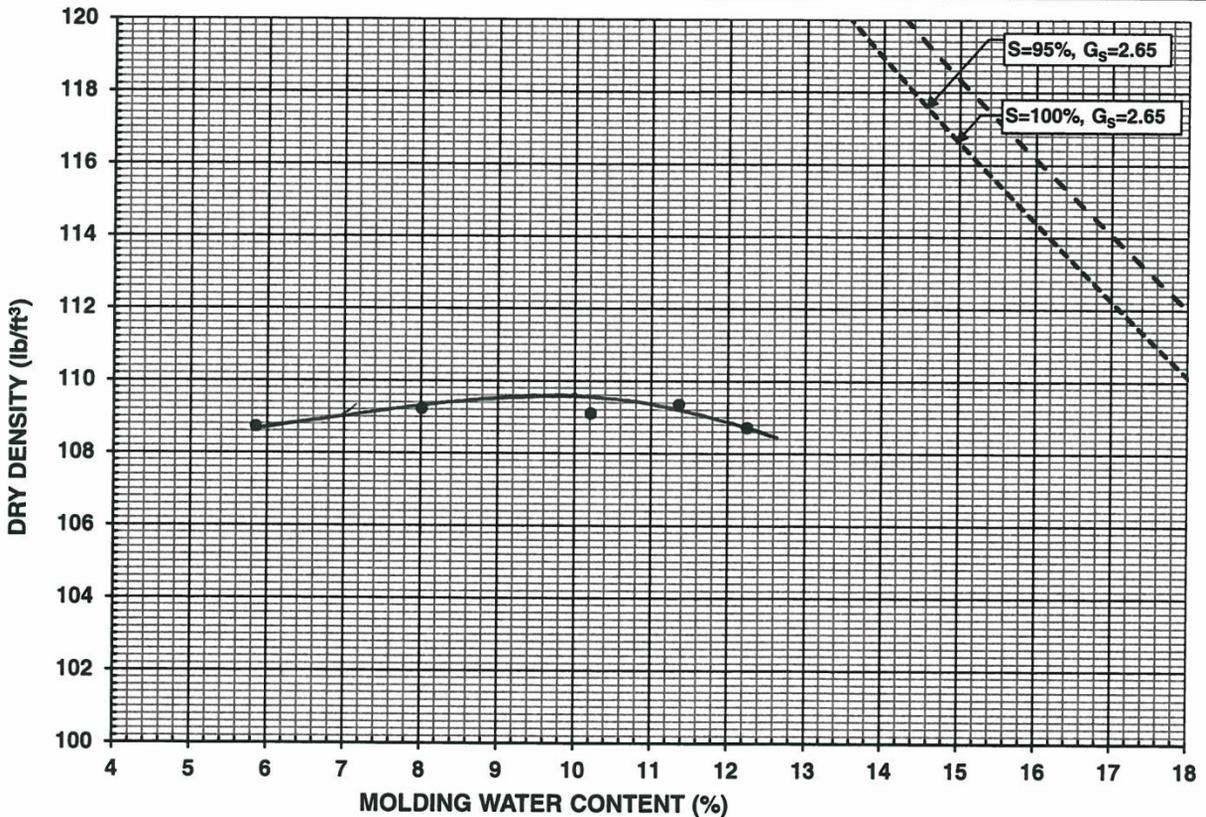

Comments: _____

The test data and all associated project information presented hereon shall be held in confidence and disclosed to other parties only with the authorization of the Client. Physical and electronic records of each project are kept for a minimum of 7 years. Test samples are kept in storage for at least 10 working days after mailing of the test report, prior to being discarded, unless a longer storage period is requested in writing and accepted by Ardaman & Associates, Inc.

Checked By: TM Date: 08/15/14