

Proctor Report

Report No: PTR:07612576-1-S1

Issue No: 1

Client: E.R. JAHNA INDUSTRIES, INC.
202 EAST STUART AVENUE
LAKE WALES, FL 33853

CC: BRIAN SANDERS
MEGHAN GAYE

Project: E.R. JAHNA SAND PERMEABILITY
ORLANDO, FL

These test results apply only to the specific locations and materials noted and may not represent any other locations or elevations. This report may not be reproduced, except in full, without written permission by Professional Service Industries, Inc. If a non-compliance appears on this report, to the extent that the reported non-compliance impacts the project, the resolution is outside the PSI scope of engagement.



Approved Signatory: James Hill (Project Engineer)
Date of Issue: 6/13/2016

Sample Details

Sample ID: 07612576-1-S1

Date Sampled: 6/2/2016

Date Received: 6/3/2016

Sampled By: Client

Specification:

Material: UNDERDRAIN SAND/MASONARY SAND

Sampling Method: Stockpiles/Trans - AASHTO T 2 - 5.3.3


General Location: E.R JAHNA SAND PIT, PERM TESTING

Location:

Tested By: Sheila Daniels

Date Tested: 6/3/2016

Dry Density - Moisture Content Relationship

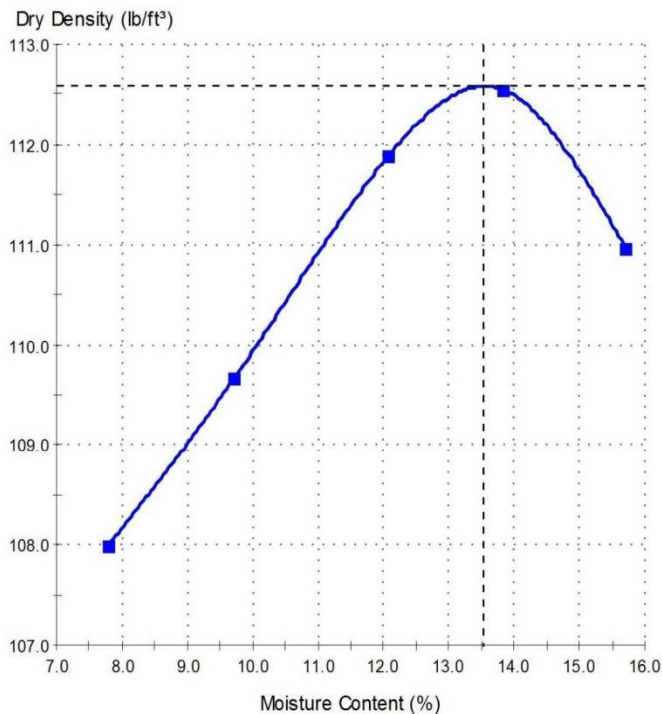

Test Results

____ AASHTO T 180 ____

Maximum Dry Density (lb/ft³): 113

Optimum Moisture Content (%): 14

Method: A

____ AASHTO T 224 ____

Corrected Maximum Dry Density (lb/ft³): 113

Corrected Optimum Moisture Content (%): 14

Comments